

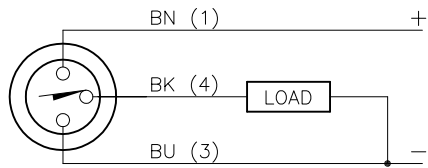


WIRING DIAGRAM

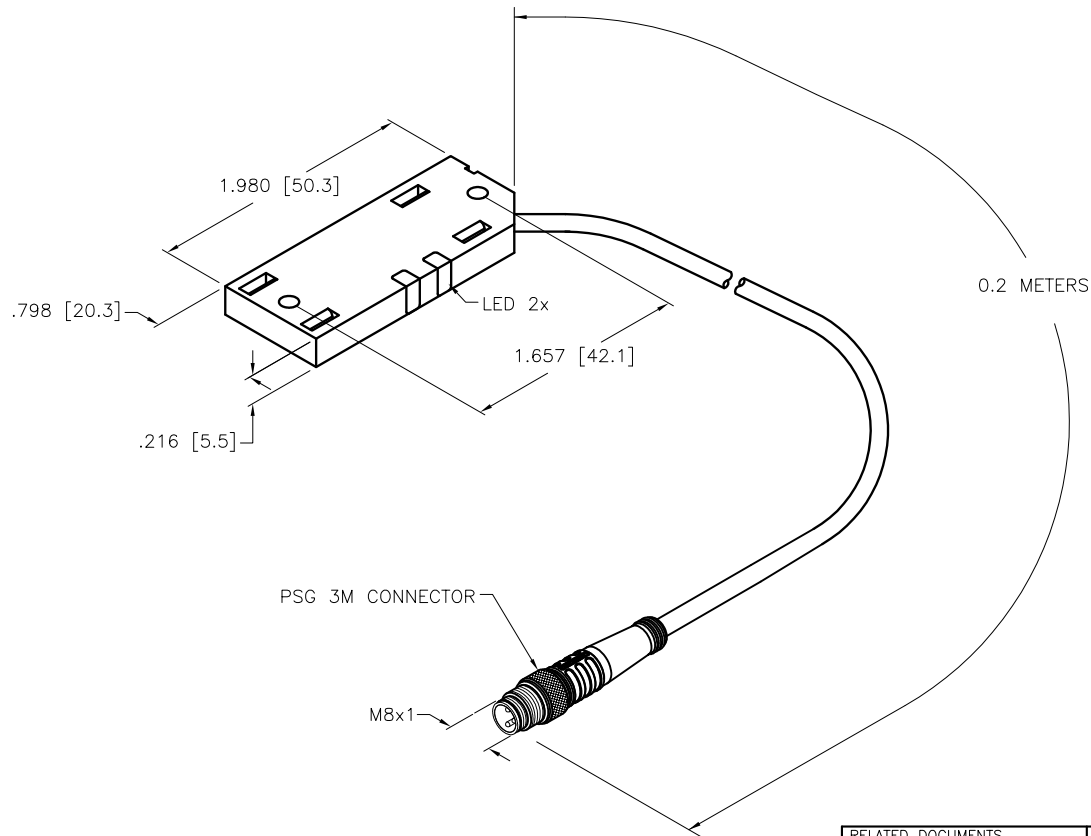

OUTPUT: AP6X2

SHORT-CIRCUIT AND OVERLOAD PROTECTED

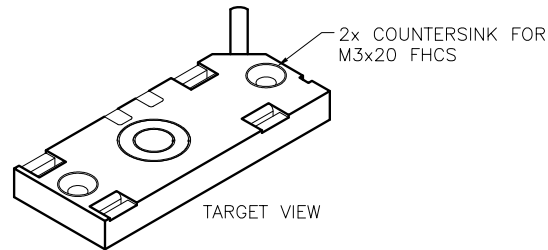

SPECIFICATIONS

| | |
|---|---|
| OPERATING VOLTAGE | 10-30 VDC |
| RIPPLE | ≤10% |
| HYSTERESIS | 2-20% (5% TYPICAL) |
| VOLTAGE DROP ACROSS CONDUCTING SENSOR | ≤1.8 V at 200 mA |
| OUTPUT FUNCTION | NORMALLY OPEN, PNP |
| TTL COMPATIBLE | NO |
| SHORT-CIRCUIT PROTECTED | YES |
| TRIGGER CURRENT FOR OVERLOAD PROTECTION | ≥ 220 mA |
| CONTINUOUS LOAD CURRENT | ≤ 200 mA |
| RESIDUAL CURRENT | <100 μA |
| NO-LOAD CURRENT | ≤15 mA |
| TIME DELAY BEFORE AVAILABILITY | ≤ 8 ms |
| POWER-ON EFFECT | Per IEC 947-5-2 |
| REVERSE POLARITY PROTECTION | YES |
| WIRE BREAK PROTECTION | YES |
| TRANSIENT PROTECTION | Per EN 60947-5-2 |
| OPERATING TEMPERATURE | -25°C to +70°C (-13°F to +158°F) |
| MAX RELATIVE TEMPERATURE DRIFT | ≤ 20 % |
| ENCLOSURE | MEETS NEMA 1, 3, 4, 6, 13 AND IEC IP67 |
| SHOCK | 30 g, 11 ms |
| VIBRATION | 55 Hz, 1 mm AMPLITUDE (IN ALL 3 PLANES) |
| LED FUNCTION | YELLOW = OUTPUT ENERGIZED GREEN = POWER ON |
| RATED OPERATING DISTANCE | 10 mm = .394" (ADJUSTABLE) |
| SWITCHING FREQUENCY | 100 Hz |
| REPEATABILITY | ≤ 2% OF RATED OPERATING DISTANCE |
| EMBEDDABLE | YES |

SOURCE DRAWING - FOR REFERENCE ONLY

| | | | | | |
|---|------------------------------------|--|--------------------------|--|--|
| RELATED DOCUMENTS 1. 2. 3. 4. | 3RD ANGLE PROJECTION | THIS DRAWING IS CONFIDENTIAL AND THE PROPERTY OF TURCK INC. USE OF THIS DOCUMENT WITHOUT WRITTEN PERMISSION IS PROHIBITED. | | 3000 CAMPUS DRIVE MINNEAPOLIS, MN 55441 1-800-544-7769 (763) 553-7300 (763) 553-0708 fax www.turck.us | |
| | MATERIAL SEE SPECS | ALL DIMENSIONS DISPLAYED ON THIS DRAWING ARE FOR REFERENCE ONLY | DRFT NF DATE 02/22/17 | DESCRIPTION BC10-QF5.5-AP6X2-0.2M-PSG3M | |
| FINISH | CONTACT TURCK FOR MORE INFORMATION | UNIT OF MEASUREMENT INCH [MILLIMETER] | | IDENTIFICATION NO. 2620189 | |
| B UPDATE ID NUMBER PER HARMONIZATION PROJECT REV DESCRIPTION | CBM 11/06/17 BY DATE ECO NO. | DO NOT SCALE THIS DRAWING | | REV B FILE: 2620189 SHEET 1 OF 1 | |

| | | | | |
|-----|--|-----|----------|---------|
| B | UPDATE ID NUMBER PER HARMONIZATION PROJECT | CBM | 11/06/17 | |
| REV | DESCRIPTION | BY | DATE | ECO NO. |